



600 Volt Secondary Bus Enclosure


Single-Phase & Three-Phase
Pad-Mounted—Outdoor

Tech Bulletin


340-100

Page 1 1993


INSTALLATION INSTRUCTIONS

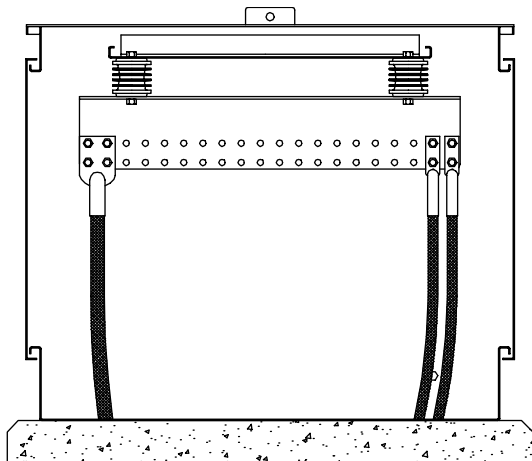

Max. Capacity = Bus Rating x 1.00
Source and Load Cables
connect to the ends of the bus

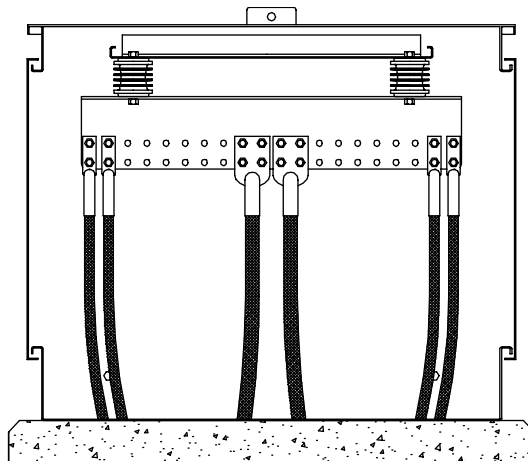


Max. Capacity = Bus Rating x 1.75
Source Cables
connect to the center of the bus
Load Cables (equal loads)
connect to the ends of the bus

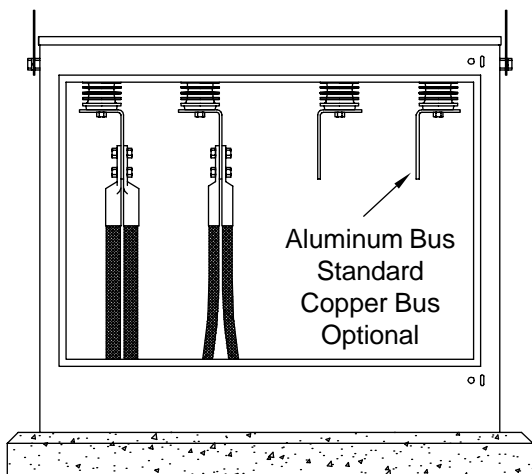

Open Bottom And Bus
Arrangement Allows Access
To All Cables For Easy
Installation And Maintenance

Ground Lugs
Accept #6 To 2/0
Ground Cable

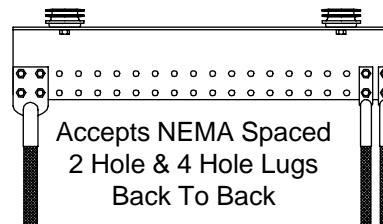

Co-ordinated Padlock And Security
Bolt Provides Bolted Door Security
With Visual Confirmation By
Supervisory Personnel